


England and Wales blackout on 9 Aug 2019

Selected indicators

JOHN KEMP
REUTERS
12 August 2019

UK power grid frequency, Aug 9, 2019

Grid code target is 50Hz +/- 0.5Hz, times in GMT

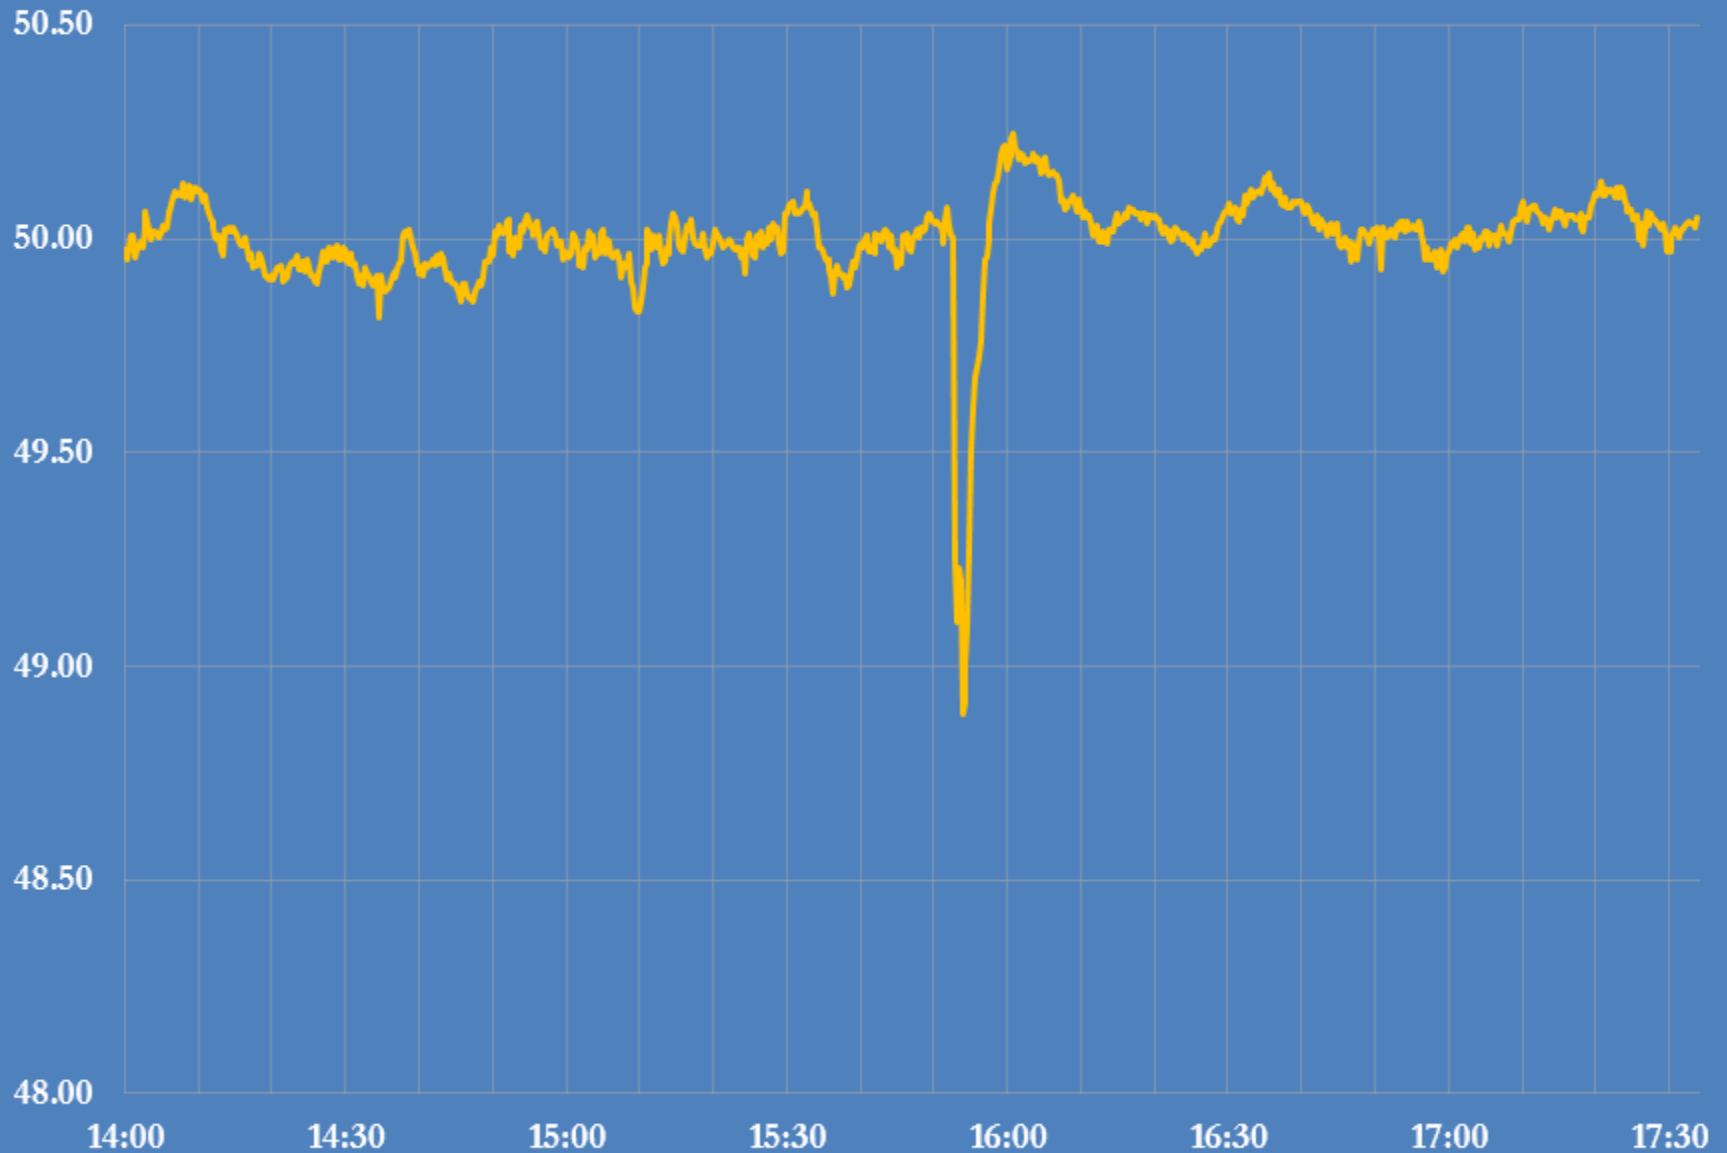


Source: Elexon

@JKempEnergy


UK power grid frequency, Aug 9, 2019

Grid code target is 50Hz +/- 0.5Hz, times in GMT

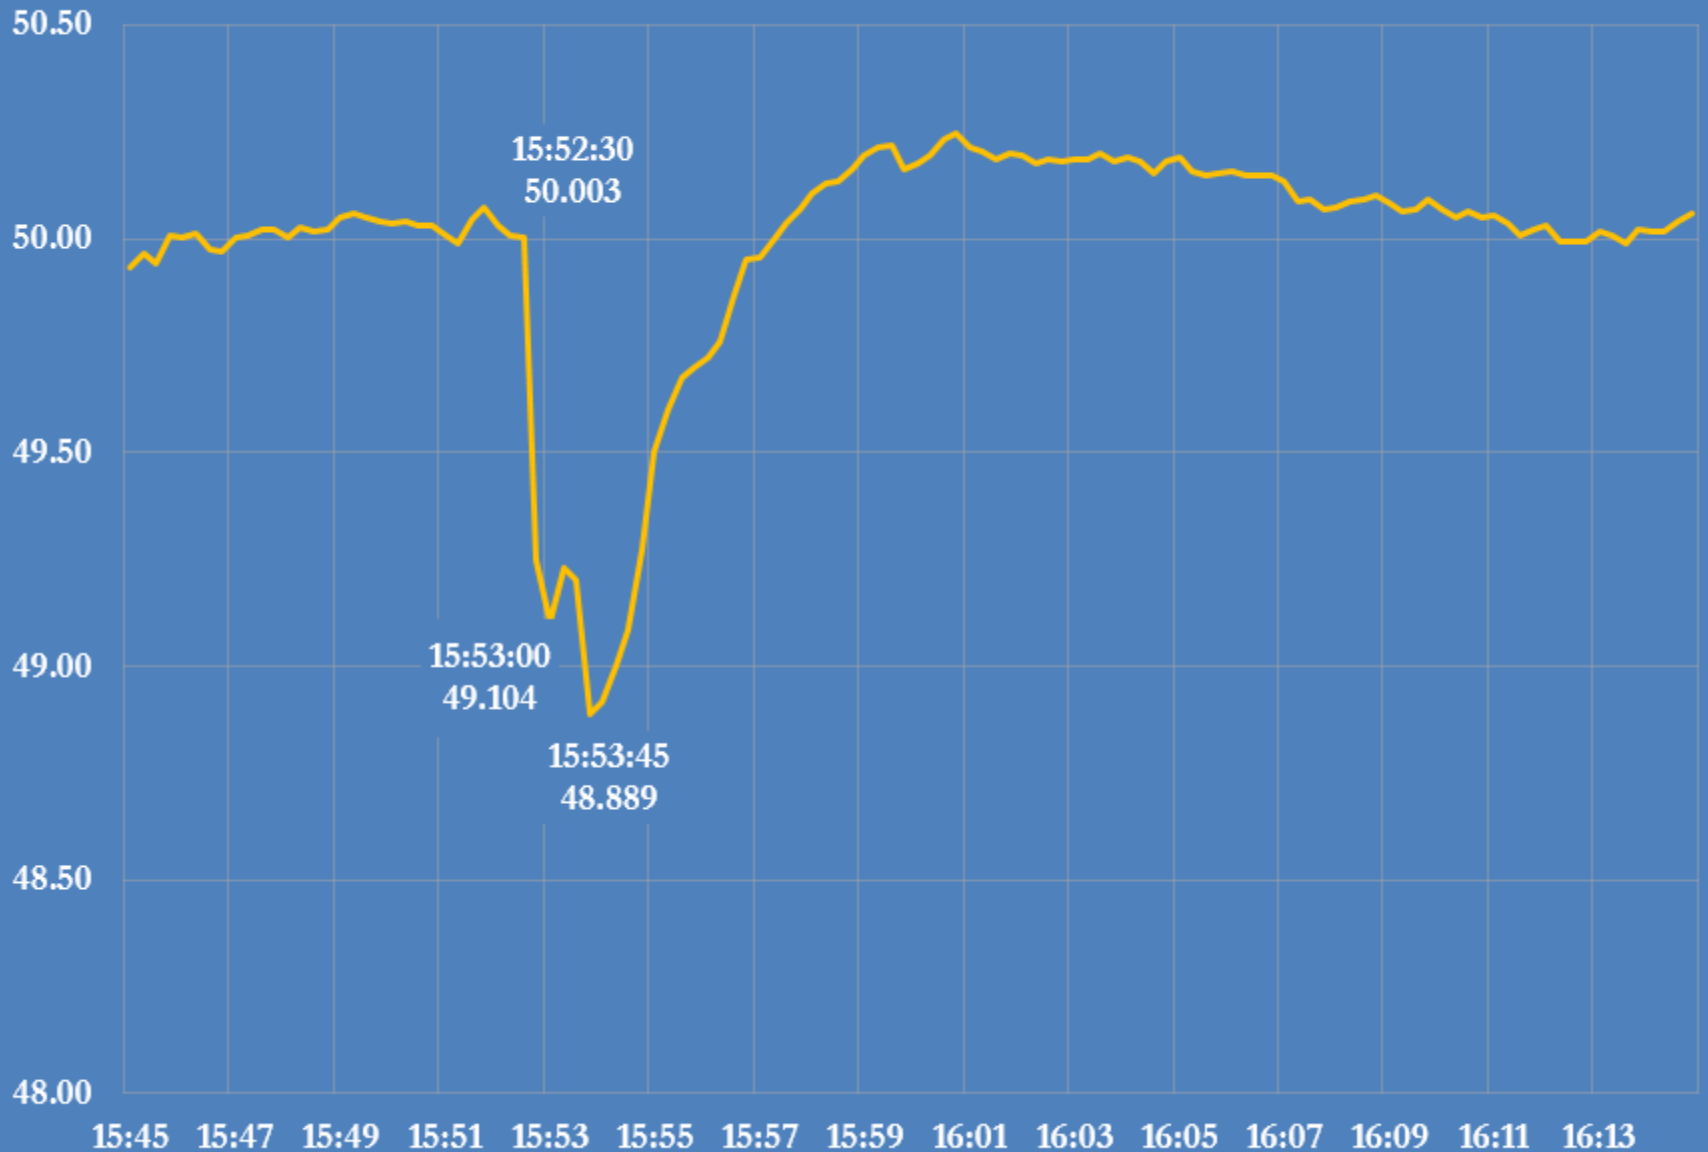


UK power generation, Aug 9, 2019

megawatts, GMT, combined cycle gas turbines

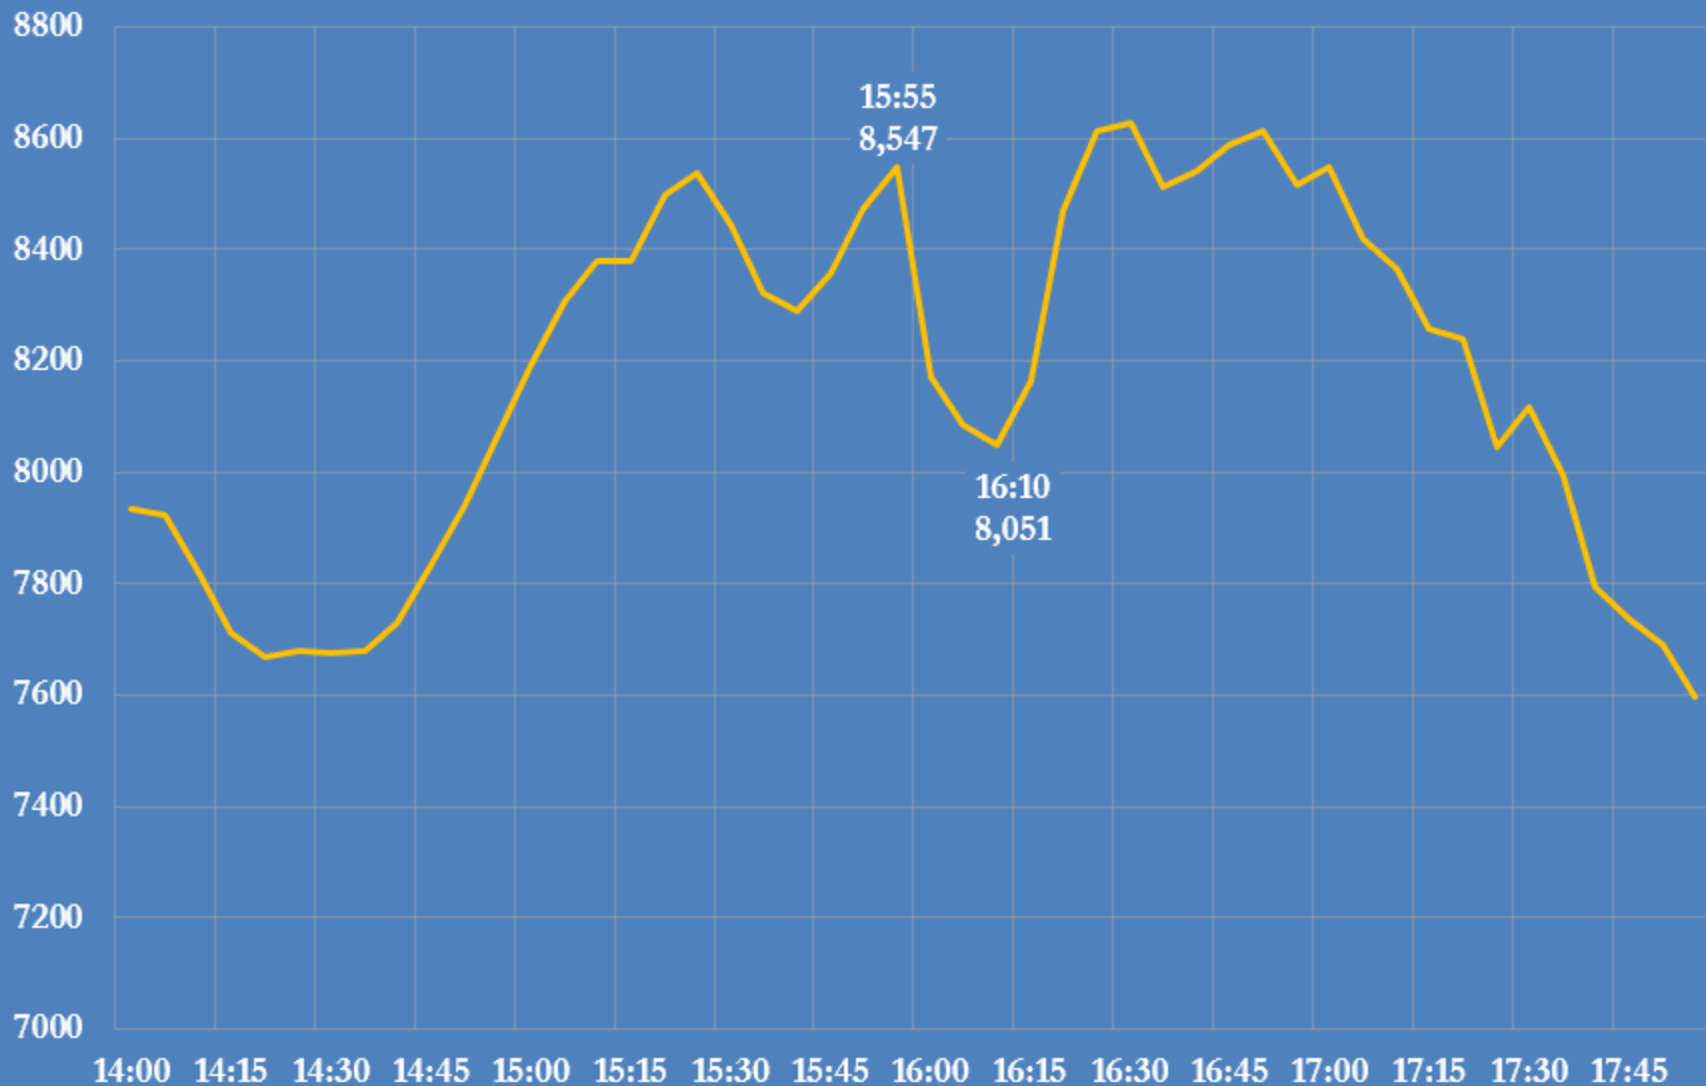


UK power generation, Aug 9, 2019

megawatts, GMT, wind power

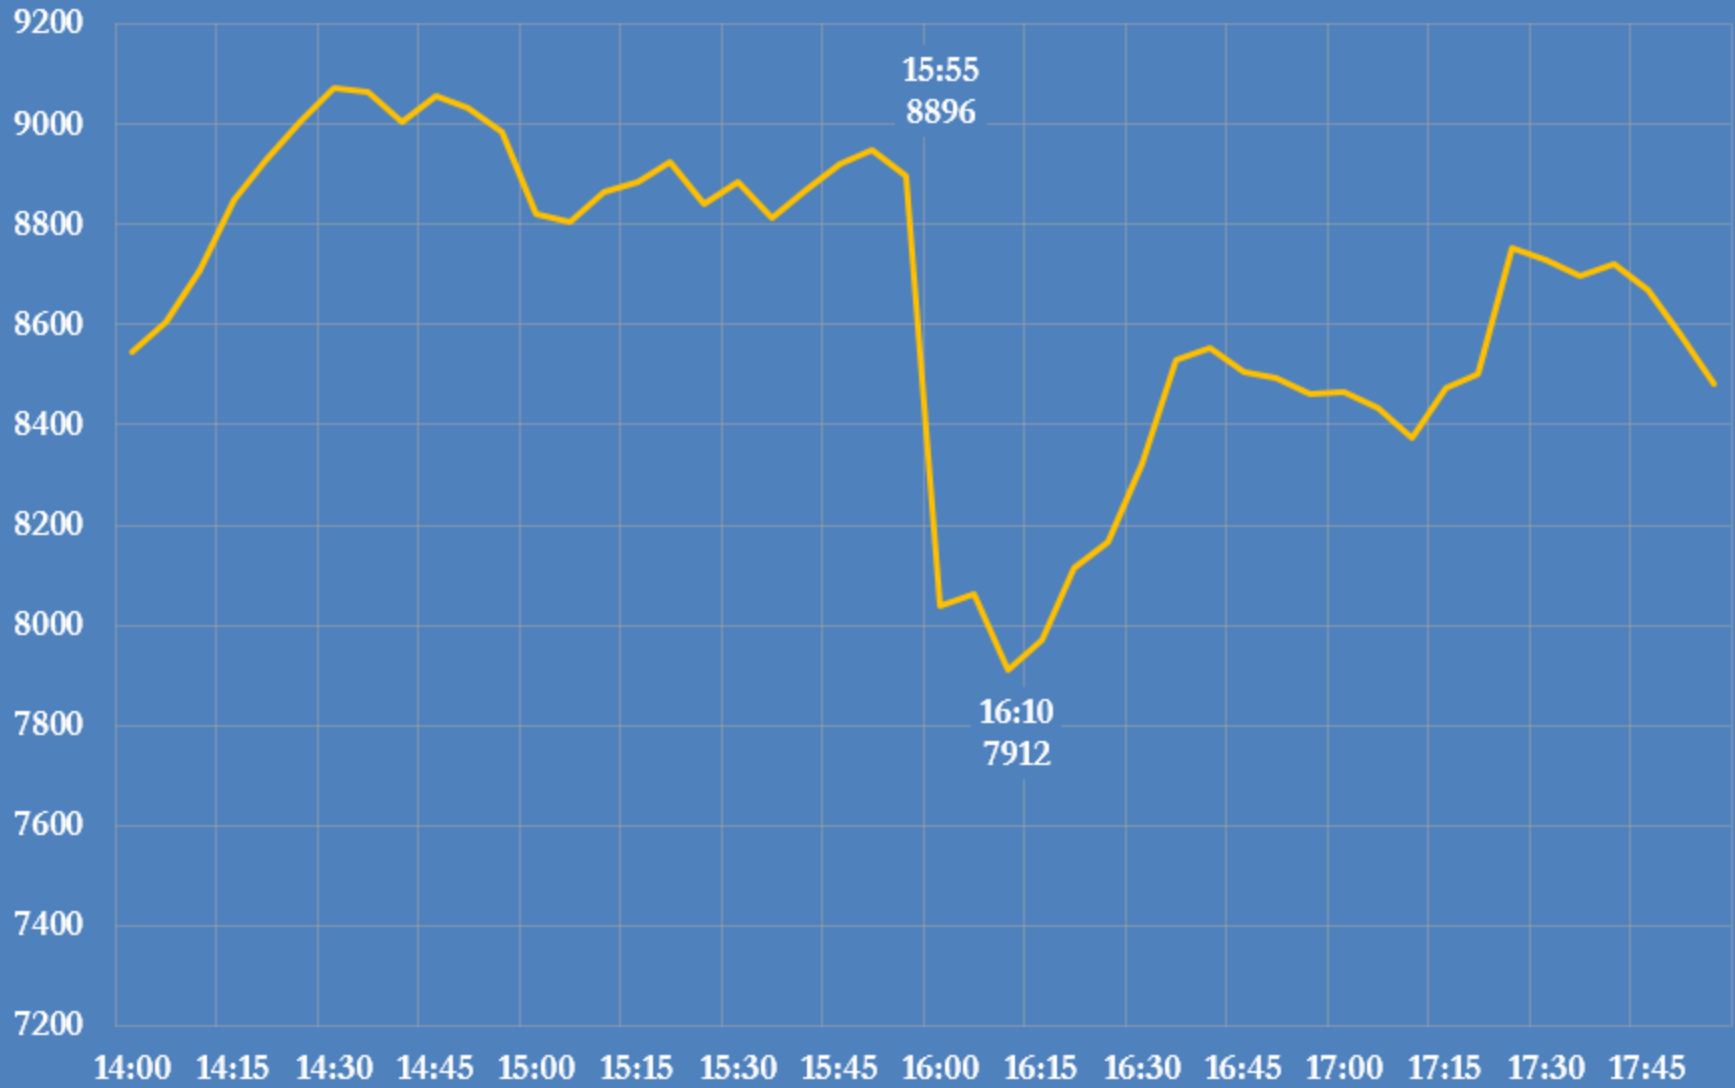

UK power generation, Aug 9, 2019

megawatts, GMT, selected sources of emergency power

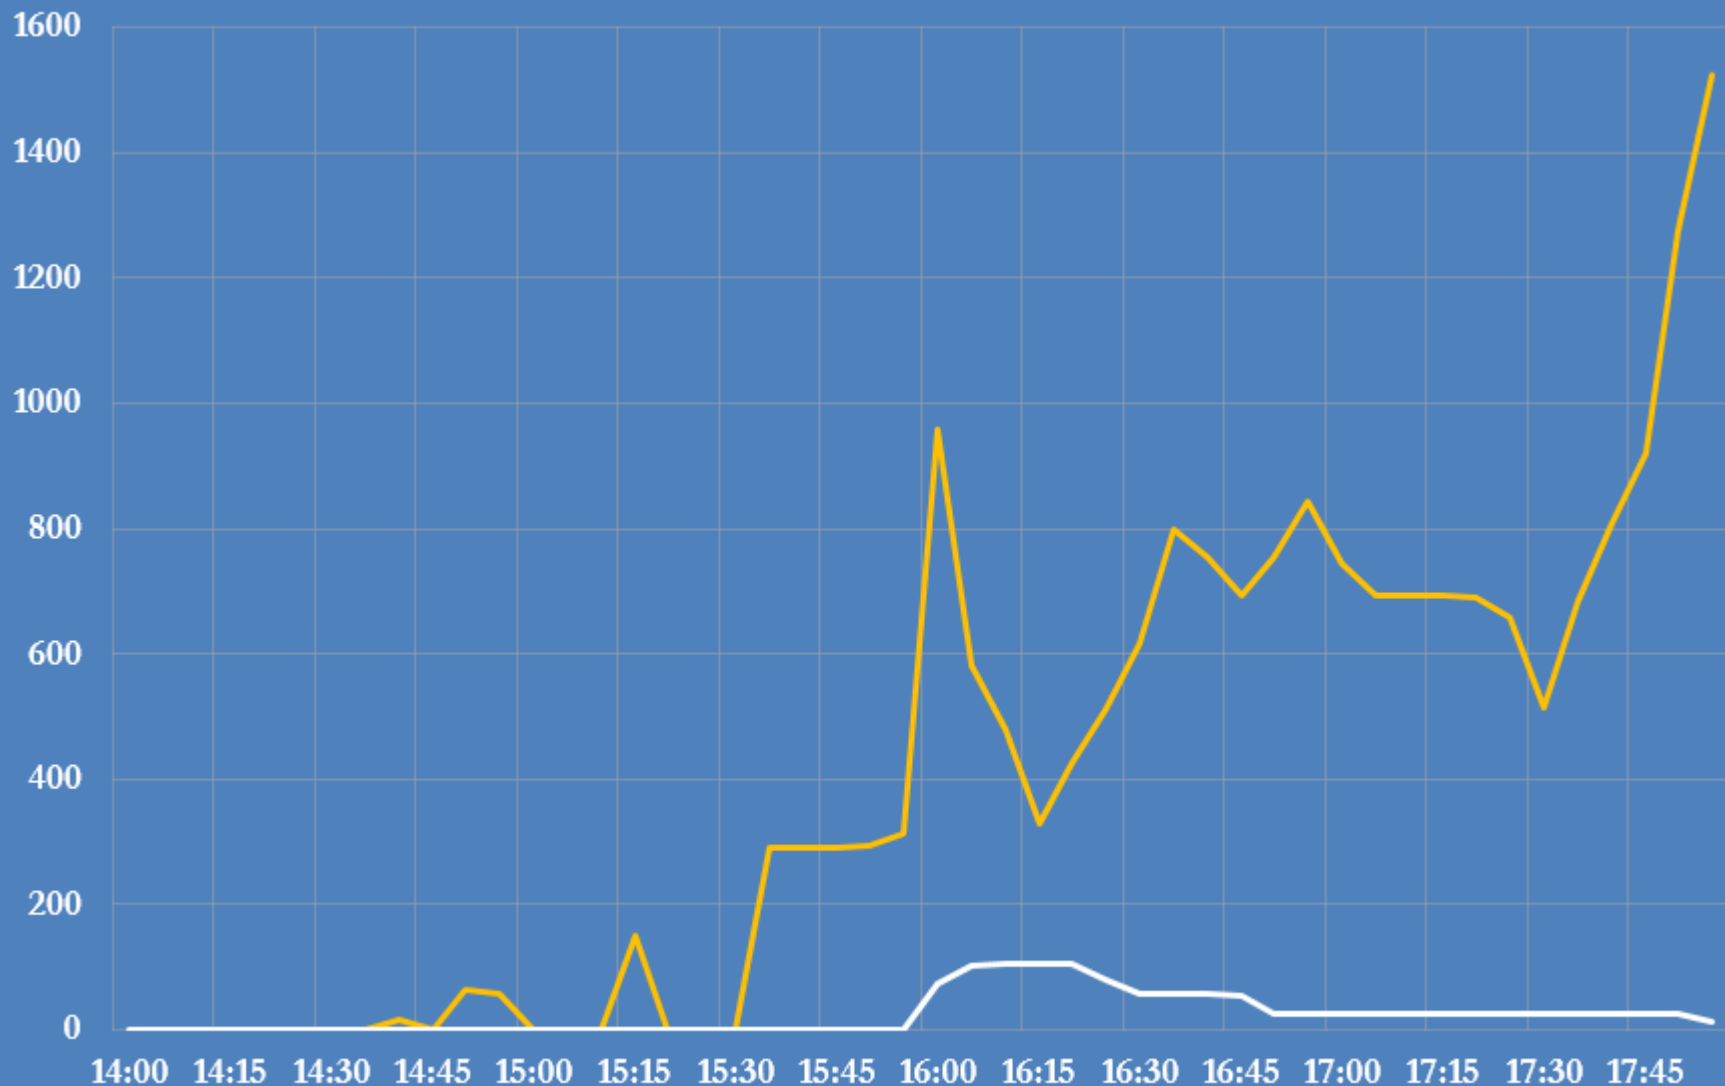


— Pumped storage
— Open-cycle gas turbines

Source: Elexon
@JKempEnergy

UK electricity imports from the Netherlands

Aug 9, 2019, megawatts, GMT

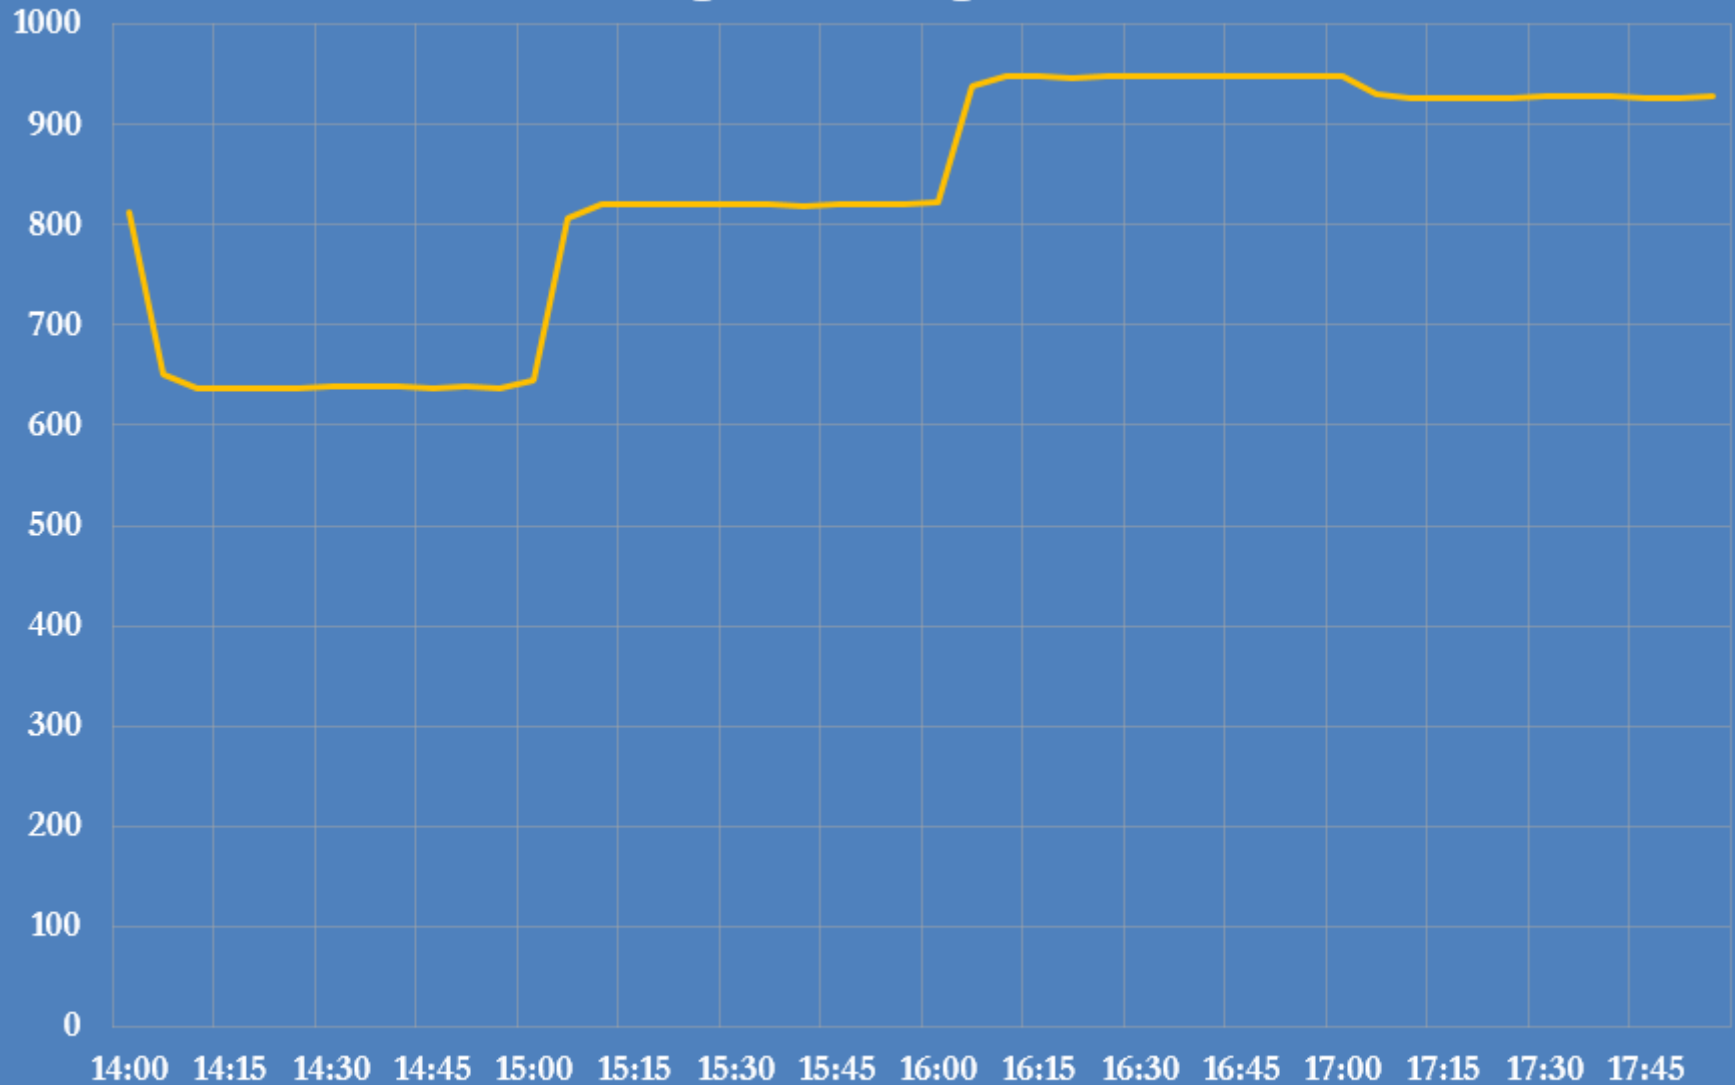

U.K. transmission system load served, 9 Aug 2019

megawatts, times in GMT

